


NOTES: 1. NOTCH TRENCH DAM A MINIMUM OF 2'-0" BEYOND UNDISTURBED MATERIAL ON SIDES AND BOTTOM OF

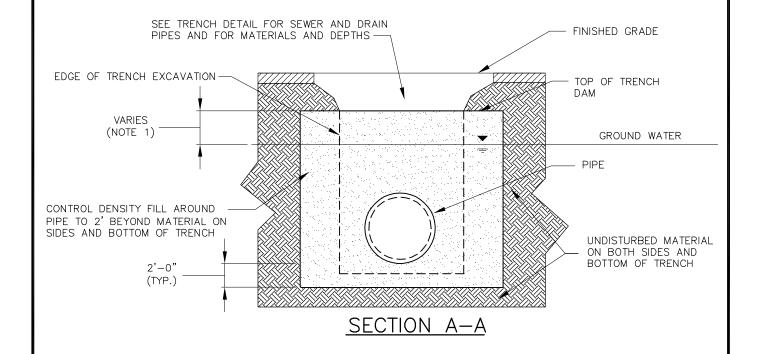

NOTES:

1. THE TOP OF THE TRENCH DAM SHALL EXTEND A MINIMUM OF 5'-0" ABOVE THE GROUND WATER LEVEL, AS DETERMINED BY THE NEAREST BORING OR BY THE ENGINEER, BUT SHALL NOT EXCEED A DEPTH OF 1'-0" BELOW FINISHED GRADE.

2. TRENCH DAMS SHALL BE INSTALLED AS INDICATED ON THE CONTRACT DRAWINGS OR AS DIRECTED BY THE ENGINEER.

3. IF PIPE MATERIAL IS DUCTILE IRON USE A NON FLY ASH BASED

CONTROL DENSITY FILL



TRENCH DAM DETAIL

CITY OF CAMBRIDGE STANDARD SPECIFICATIONS AND DETAILS

DATE SPEC. SECTION REF#: 02210 SCALE: N.T.S. 02/05 2210.2 ISSUE: