


SANITARY SEWER
OR STORM DRAIN




WATER LINE


12" (MIN)
CONCRETE
ENCASEMENT
TYP. ALL
AROUND

SECTION A-A

10' MIN. (TYP.)

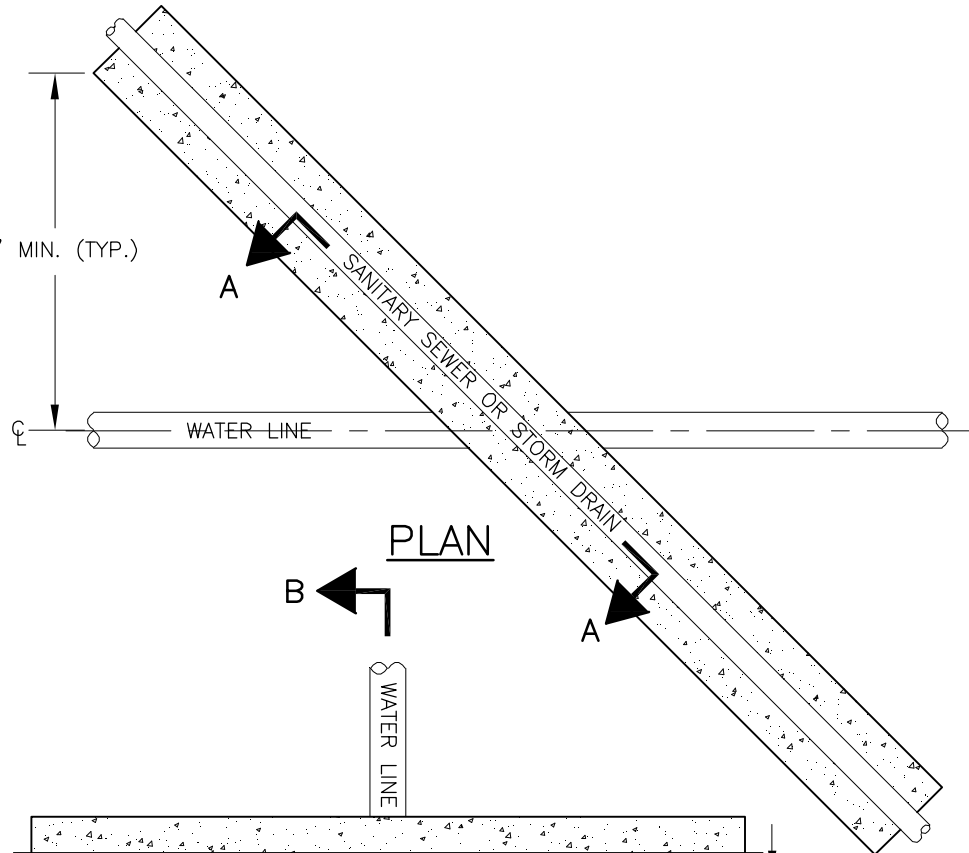


PLAN



WATER LINE


12" (MIN.)
CONCRETE ENCASEMENT
TYP. ALL AROUND



WATER LINE

PROTECT WATER MAIN WITH
30lb FELT ROOFING PAPER
PRIOR TO PLACING
CONCRETE

SANITARY SEWER
OR STORM DRAIN



10' MIN.
TYP.

12" (MIN) CONCRETE
ENCASEMENT TYP.
ALL AROUND

SECTION B-B



PLAN

NOTE:

1. CONCRETE SHALL HAVE A MINIMUM 3,000 PSI STRENGTH

THE WORKS
CAMBRIDGE
DEPARTMENT
OF PUBLIC
WORKS

STORM DRAIN AND SANITARY SEWER CROSSING ABOVE WATER MAIN

CITY OF CAMBRIDGE STANDARD SPECIFICATIONS AND DETAILS

SCALE: N.T.S.

DATE
OF ISSUE: 02/05

SPEC. SECTION REF#: 02630

2630.1