


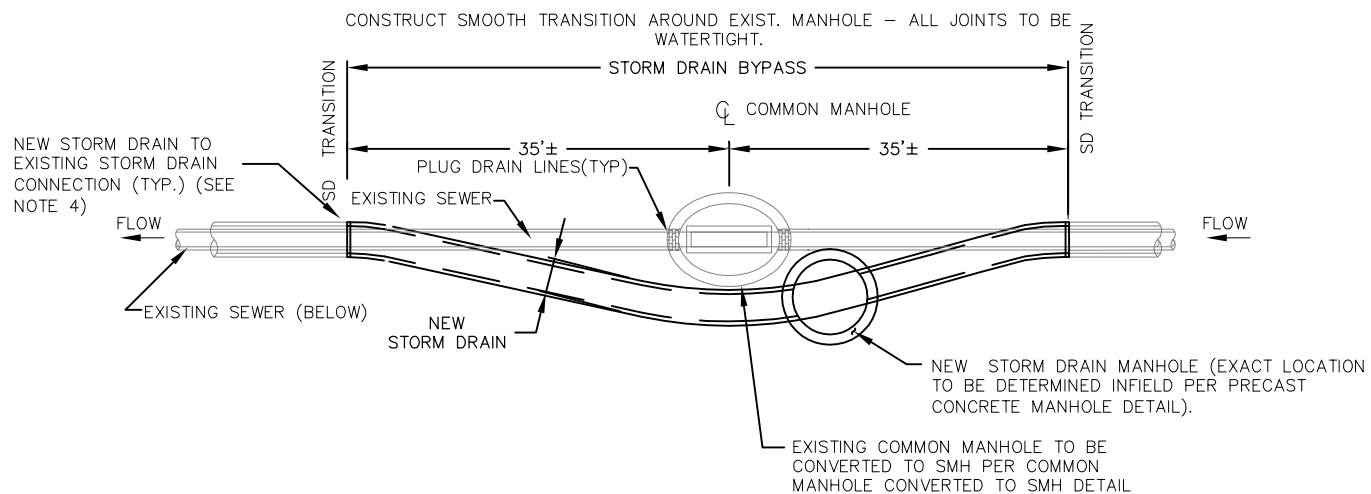

NOTES:

1. LOCATE ALL EXISTING STORM DRAIN CONNECTIONS WITHIN THE PORTION OF EXISTING STORM DRAIN THAT IS TO BE ABANDONED AND RECONNECT THOSE CONNECTIONS TO THE STORM DRAIN.
2. ANY PORTION OF THE EXISTING STORM DRAIN THAT IS TO BE ABANDONED IN PLACE SHALL BE FILLED WITH FLOWABLE CONCRETE FILL AND PLUGGED.
3. VERIFY ALL DRAIN CONNECTIONS TO THE PROPOSED ABANDONED SECTION OF DRAIN, IF ANY LIVE CONNECTIONS EXIST, COORDINATE WITH THE ENGINEER TO PROVIDE RECONNECTION. IF SERVICE IS NOT LIVE, THE CONNECTION AT THE STORM DRAIN SHALL BE PLUGGED.
4. SEE THE APPROPRIATE SPECIFICATION OR STANDARD FOR THE PROPOSED STORM DRAIN MATERIAL FOR PIPE TO PIPE CONNECTION REQUIREMENTS.

95% DETAILS
NOT FOR CONSTRUCTION

THE WORKS
CAMBRIDGE
DEPARTMENT
OF PUBLIC

COMMON MANHOLE SEPARATION - TYPE 3 STORM DRAIN BYPASS

CITY OF CAMBRIDGE STANDARD SPECIFICATIONS AND DETAILS

SCALE: N.T.S.

DATE
OF ISSUE: 02/05

SPEC. SECTION REF#: 02252

2252.11